

Date/Time Manual at 07:21:04 August 28, 2010
Range Geo : 10.00 in/s
Record Time 25.0 sec at 1024 sps
Job Number: 5177
Notes

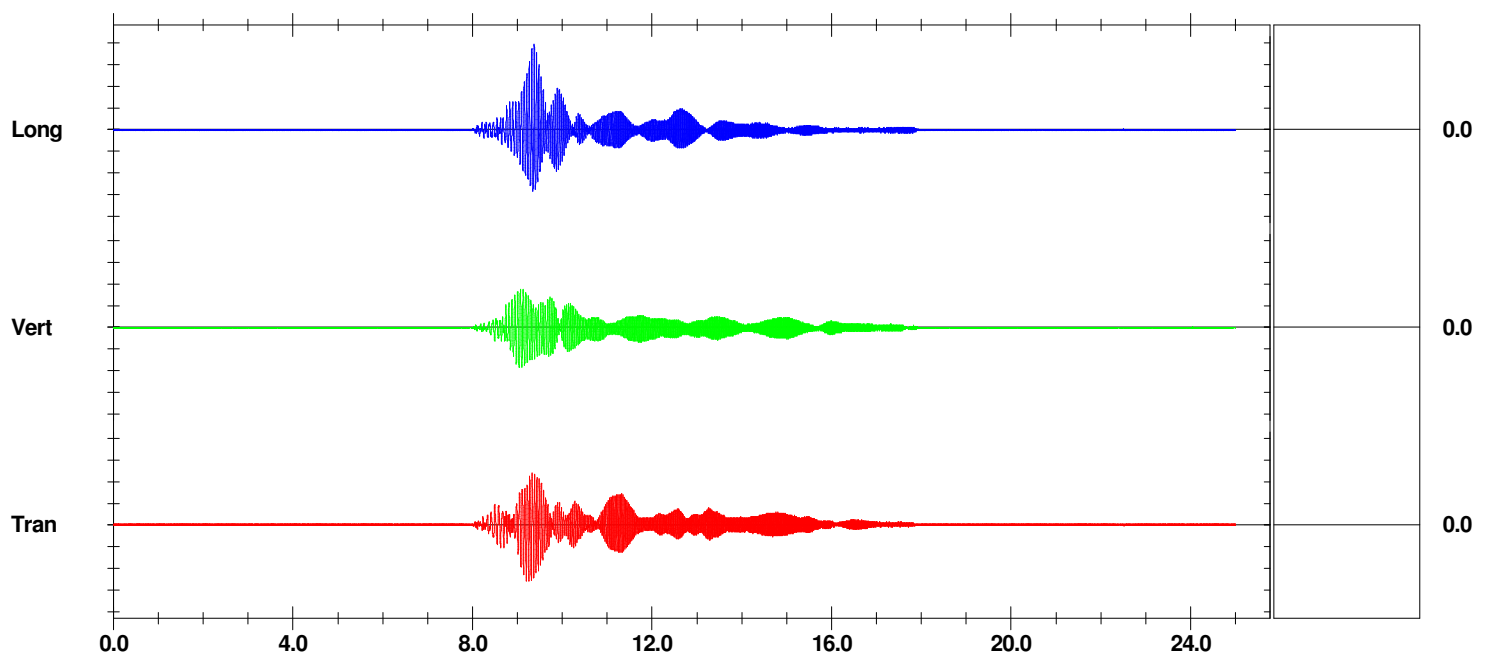
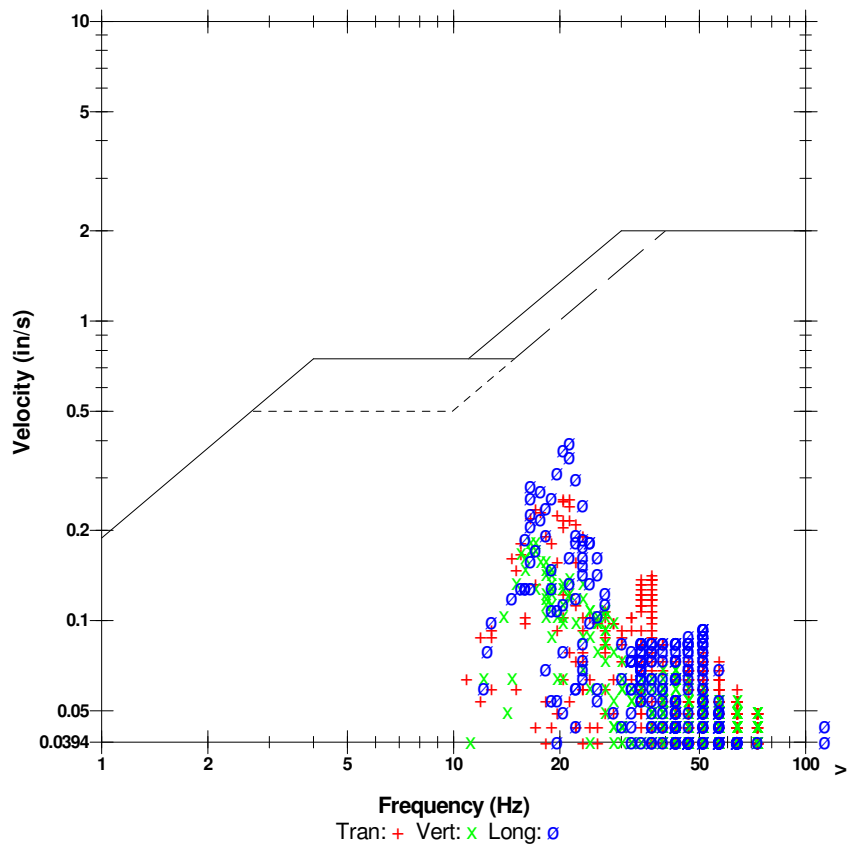
Serial Number BE11100 V 10.10-8.17 MiniMate Plus
Battery Level 6.4 Volts
Unit Calibration October 21, 2009 by Instantel Inc.
File Name M100DE0F.340
Post Event Notes

Extended Notes

Measured at sump pump 60' from vibesa at station 195.5

	Tran	Vert	Long	
PPV	0.260	0.185	0.395	in/s
ZC Freq	21	17	21	Hz
Time (Rel. to Trig)	9.196	9.037	9.375	sec
Peak Acceleration	0.106	0.0663	0.146	g
Peak Displacement	0.00190	0.00184	0.00304	in
Sensor Check	Disabled	Disabled	Disabled	
Frequency	***	***	***	Hz
Overswing Ratio	***	***	***	

Peak Vector Sum 0.404 in/s at 9.376 sec

USBM RI8507 And OSMRE


Sensor Check