

Date/Time Manual at 10:50:36 August 16, 2010
Range Geo : 10.00 in/s
Record Time 25.0 sec at 1024 sps
Job Number: 5177
Notes

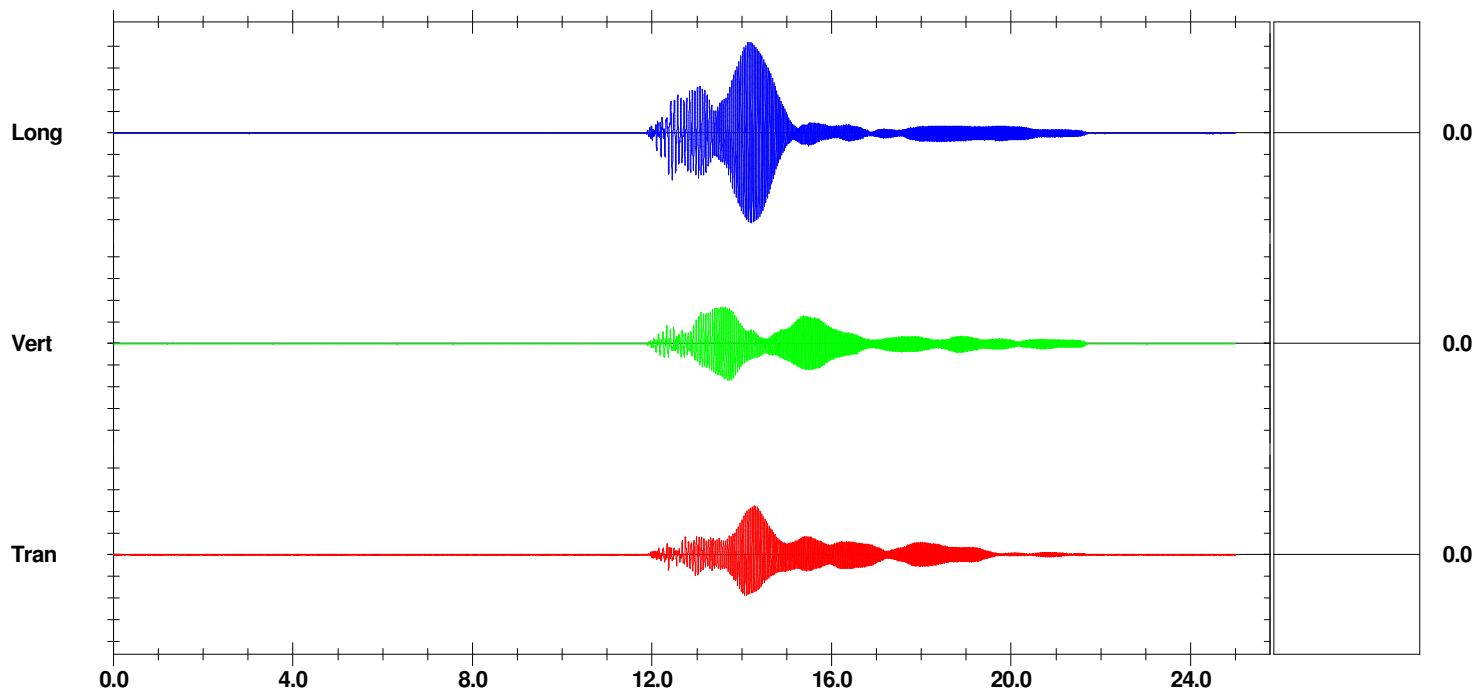
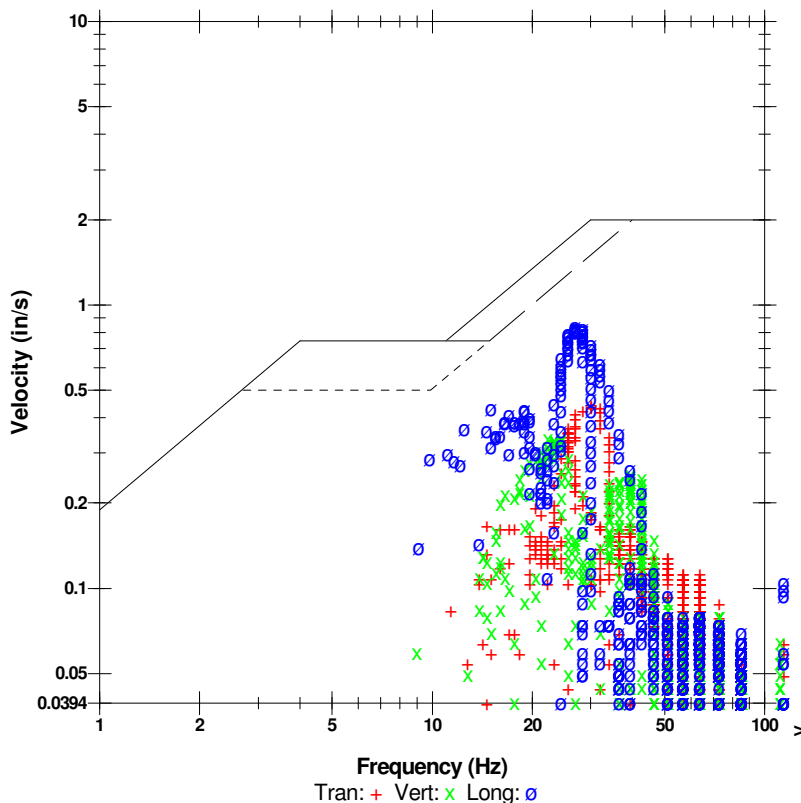
Serial Number BE11100 V 10.10-8.17 MiniMate Plus
Battery Level 6.4 Volts
Unit Calibration October 21, 2009 by Instantel Inc.
File Name M100DDEG.SC0
Post Event Notes

Extended Notes

measured at concret irrigation ditch 20' from vibes at station 151.5

	Tran	Vert	Long	
PPV	0.450	0.340	0.840	in/s
ZC Freq	30	22	27	Hz
Time (Rel. to Trig)	14.270	13.694	14.166	sec
Peak Acceleration	0.225	0.172	0.411	g
Peak Displacement	0.00240	0.00245	0.00478	in
Sensor Check	Disabled	Disabled	Disabled	
Frequency	***	***	***	Hz
Overswing Ratio	***	***	***	

Peak Vector Sum 0.858 in/s at 14.166 sec

USBM RI8507 And OSMRE


Sensor Check