

Date/Time Manual at 08:18:55 August 13, 2010
Range Geo : 10.00 in/s
Record Time 30.0 sec at 1024 sps
Job Number: 5177
Notes

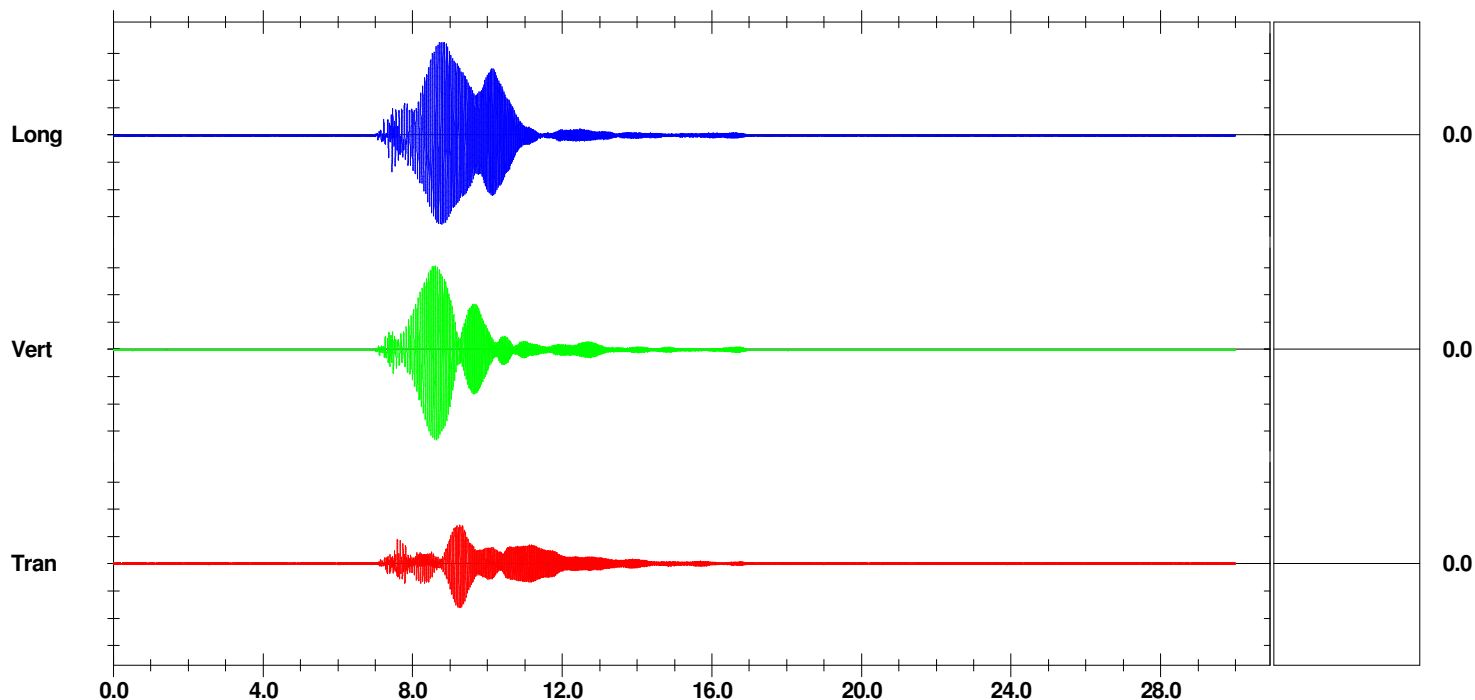
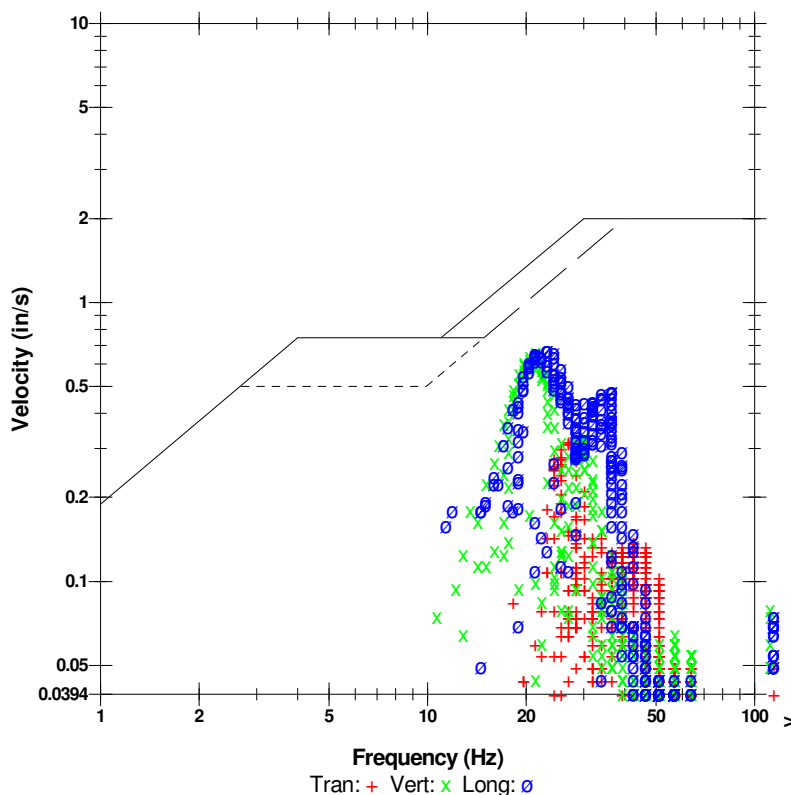
Serial Number BE11100 V 10.10-8.17 MiniMate Plus
Battery Level 6.4 Volts
Unit Calibration October 21, 2009 by Instantel Inc.
File Name M100DD8P.RJ0
Post Event Notes

Extended Notes

Measured at concrete irrigation ditch 53' from vibes at station 153.5

	Tran	Vert	Long	
PPV	0.320	0.665	0.680	in/s
ZC Freq	28	21	23	Hz
Time (Rel. to Trig)	9.239	8.639	8.719	sec
Peak Acceleration	0.159	0.239	0.265	g
Peak Displacement	0.00194	0.00478	0.00462	in
Sensor Check	Disabled	Disabled	Disabled	
Frequency	***	***	***	Hz
Overswing Ratio	***	***	***	

Peak Vector Sum 0.735 in/s at 8.895 sec

USBM RI8507 And OSMRE


Sensor Check