

Date/Time Manual at 07:34:15 August 8, 2010
Range Geo : 10.00 in/s
Record Time 30.0 sec at 1024 sps
Job Number: 5177
Notes

Serial Number BE11100 V 10.10-8.17 MiniMate Plus
Battery Level 6.4 Volts
Unit Calibration October 21, 2009 by Instantel Inc.
File Name M100DCZE.D30
Post Event Notes



Extended Notes

One Vibe near abandoned Sump pump near station 199.5

	Tran	Vert	Long	
PPV	0.330	0.705	0.520	in/s
ZC Freq	30	20	30	Hz
Time (Rel. to Trig)	17.045	16.766	17.138	sec
Peak Acceleration	0.225	0.225	0.278	g
Peak Displacement	0.00275	0.00529	0.00270	in
Sensor Check	Disabled	Disabled	Disabled	
Frequency	***	***	***	Hz
Overswing Ratio	***	***	***	

Peak Vector Sum 0.726 in/s at 16.766 sec

USBM RI8507 And OSMRE

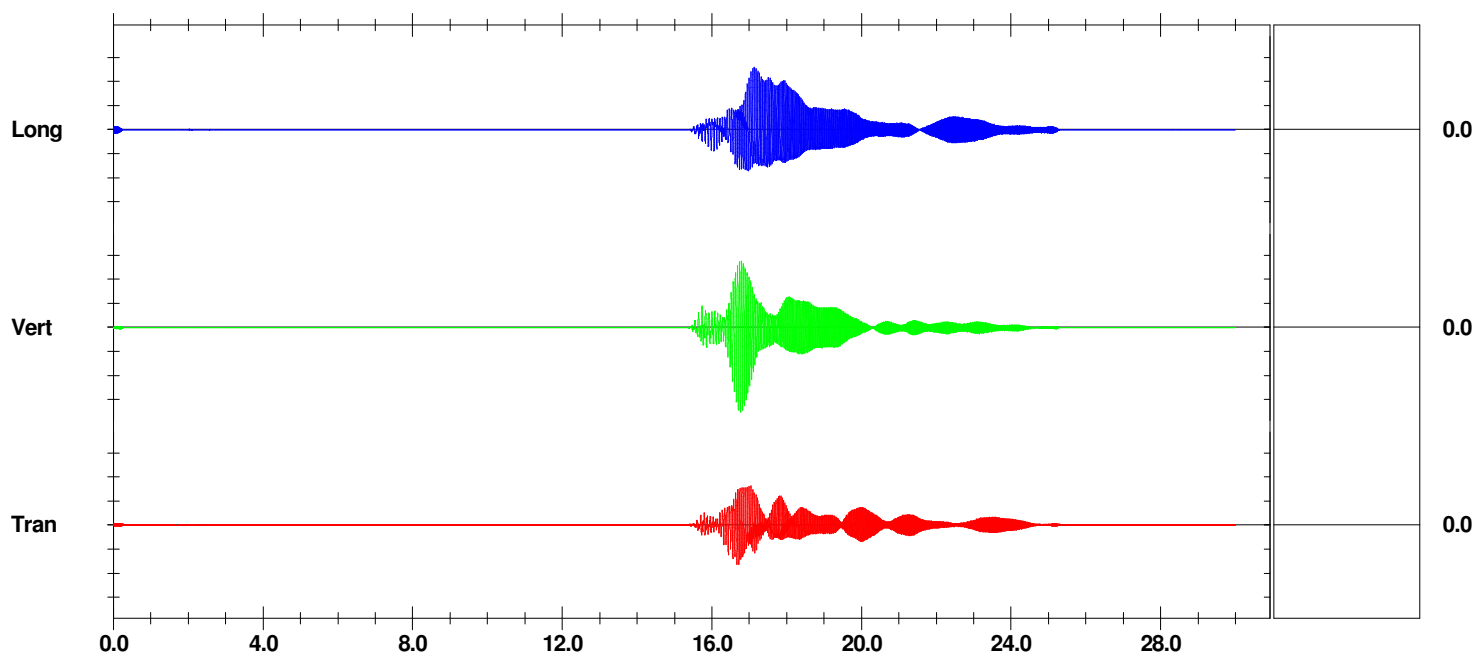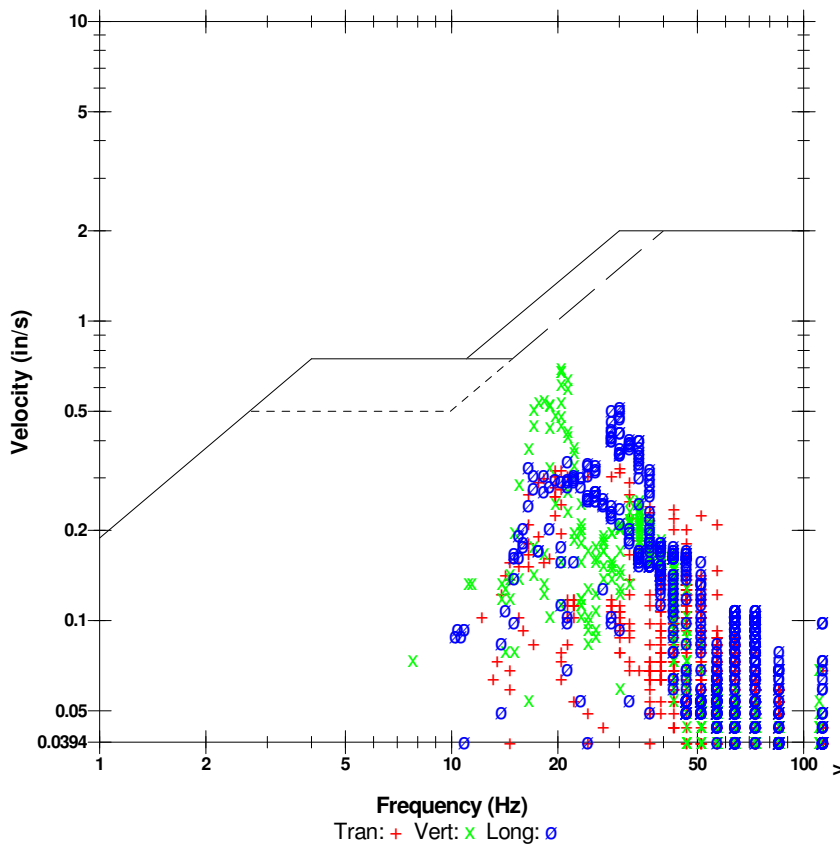

Sensor Check